
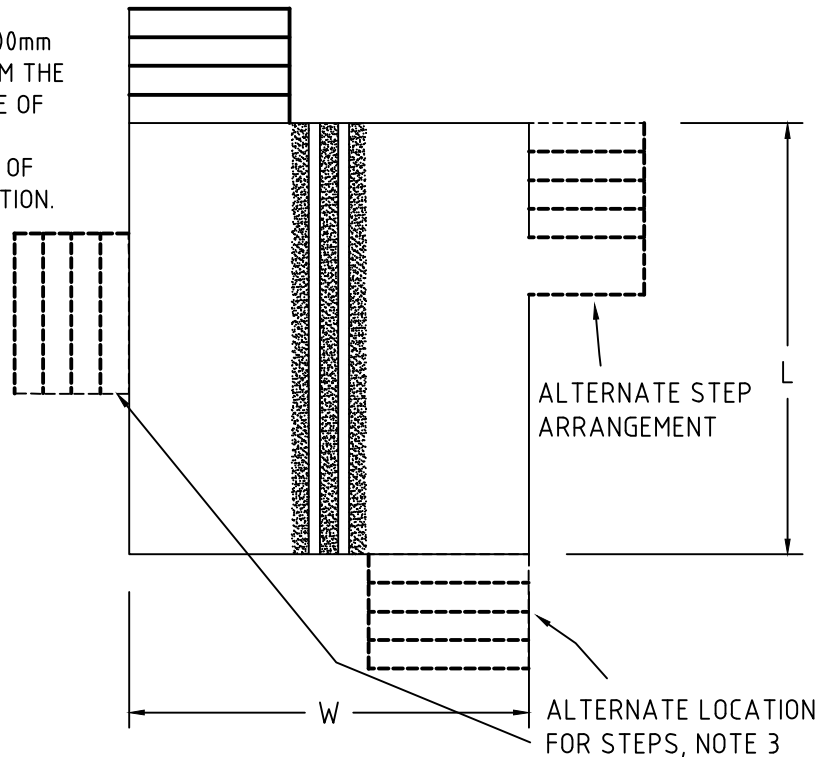


ANGLE OF REPOSE		
DRY CLAY	1:1	45°
WET CLAY	4:1	14°
CLEAN SAND	4:1	14°
DECOMPOSED ROCK	4:1	14°

NOTES:

1. FOR DETAILED NOTES, REFER TO EVOENERGY DRAWING 394-025.
2. UNLESS INDICATED, ALL DIMENSIONS ARE IN MILLIMETRES AND ARE MINIMUM REQUIREMENTS.
3. ON SITE VARIATIONS SHALL BE APPROVED BY EVOENERGY'S AUTHORISED OFFICER.
4. ALL EXCAVATED SOIL TO BE LOCATED AT LEAST 1000mm FROM THE EDGE OF THE PIT AND SLOPED AWAY FROM THE TRENCH NO STEEPER THAN INDICATED BY THE ANGLE OF REPOSE TABLE.
5. FOR ADDITIONAL INFORMATION, REFER TO THE SUITE OF CABLE PIT DRAWINGS TABLE AS PER THEIR DESCRIPTION.

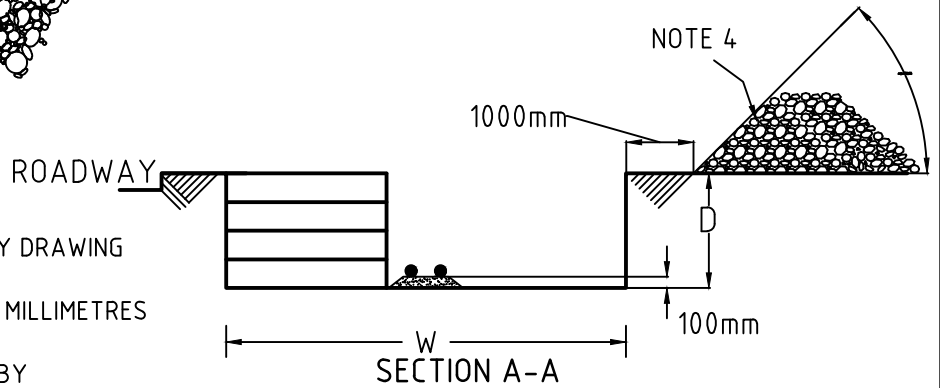

No	Revision	Date	Checked	Approved

The information contained within this drawing & associated electronic file shall remain the property of Evoenergy and shall not be copied or used for any other purpose without express written permission from Evoenergy. © Evoenergy, 2021.

ACT Cadastral information supplied by the ACT Environment & Sustainable Development Directorate. © ACT Gov. 2021.

evoenergy

**CABLE HAULAGE & JOINT PIT
EXCAVATED NATURAL GROUND
EXCAVATION AND GENERAL REQUIREMENTS**

Drawn: J. Ryan	Date: 24/09/2024
Designed: N. Azizi	
Checked: J. Primmer	24/09/2024
Approved: N. Azizi	24/09/2024

Project No:	Status: Current
Work Pack No:	File:

A4	394-023	REV
-----------	----------------	-----