


FIXED LOUVRES


TYPICAL CONFORMING DETAILS (alternatives considered)

SHOP DRAWINGS FOR ALTERNATIVES ARE TO BE PRESENTED TO ActewAGL FOR REVIEW AND APPROVAL

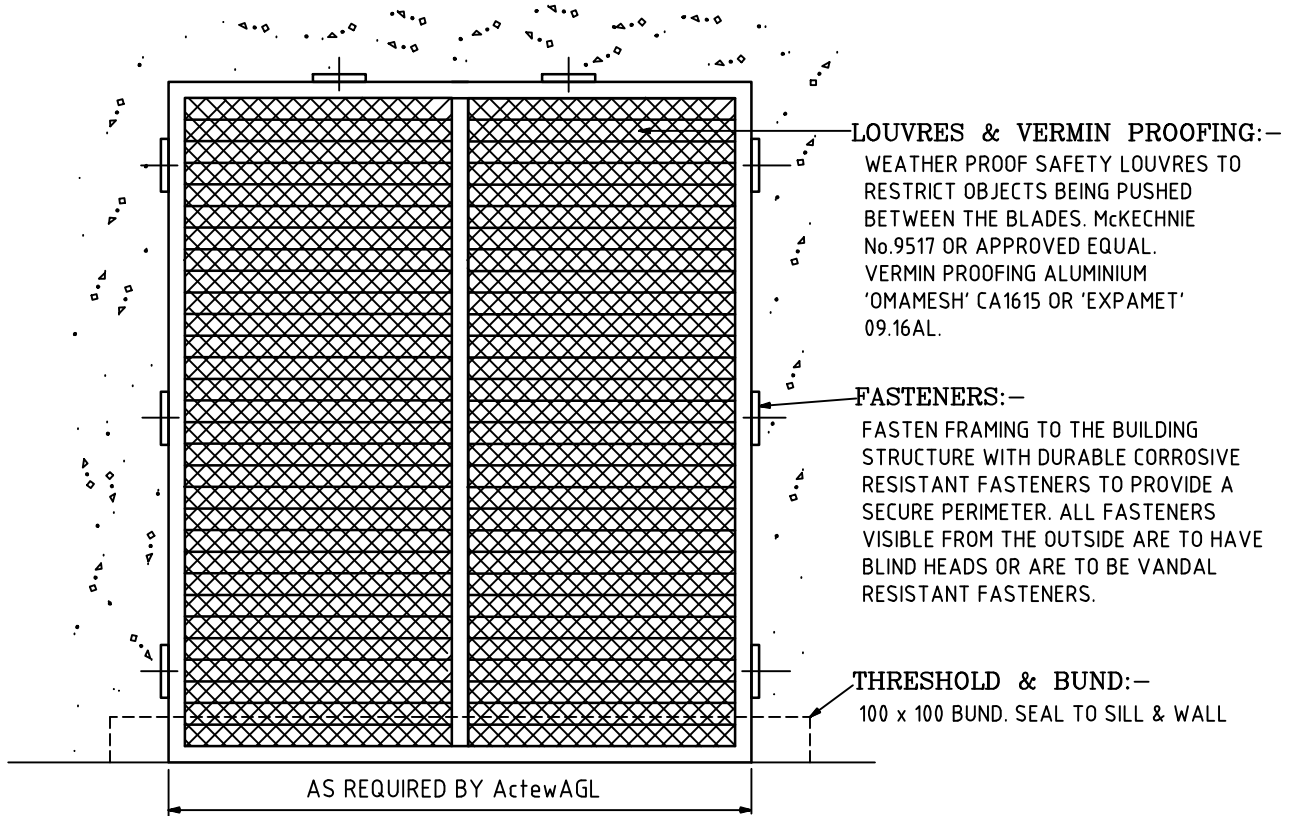

INTERNAL ELEVATION

(PANEL SIZE NOT LIMITED. SUPPLY AND FIX MID-SPAN LOUVRE SUPPORTS AS REQUIRED FOR STRENGTH AND DURABILITY)

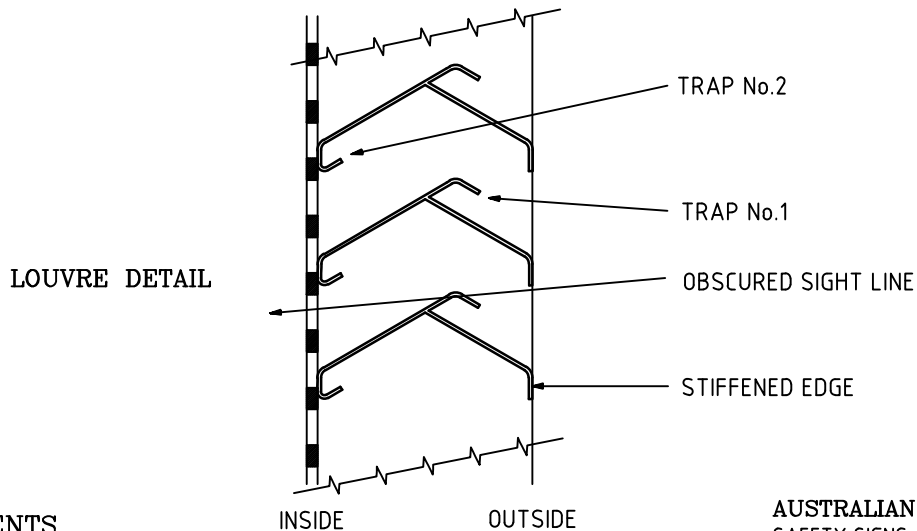

BCA REQUIREMENTS

ActewAGL REQUIREMENTS

BUND 100 x 100mm MINIMUM 1200mm MAXIMUM LENGTH MASONRY BUND SILICON SEAL TO SILL & WALL

AUSTRALIAN STANDARDS

SAFETY SIGNS AS1319

"DANGER HIGH-VOLTAGE-KEEP OUT"

350W x 175H

					The information contained within this drawing & associated electronic file shall remain the property of ActewAGL and shall not be copied or used for any other purpose without express written permission from ActewAGL. © ActewAGL. 2017. ACT Cadastral information supplied by the ACT Environment & Sustainable Development Directorate. © ACT Gov. 2017.
C	UPDATED AS PART OF CHAMBER SUBSTATION STANDARDS REVIEW	29/11/2017	C. Desai	W. Ibrahim	
B	LOGO UPDATED, MAXIMUM LENGTH OF BUND ADDED	31/03/2008	AC	GA	
No	Revision	Date	Checked	Approved	



FIXED LOUVRES FOR INDOOR CHAMBER SUBSTATIONS

Drawn:	R. Cross	Date:	1/09/1997
Designed:	E. Amaratunga		
Checked:	M. Charlton		
Approved:			

Project No:	Status: Current	A4	4951-30	REV C
Work Pack No:	File:			